
J□B NAME:	DRAWING NUMBER
RECOMMENDED MACHINE ROOM	REMI-MR1

## NOTES:

- (A) A GFI RECEPTACLE IS TO BE PROVIDED IN THE ELEVATOR MACHINE ROOM / SPACE (PER NEC 2002-BY OTHERS)
- (B) MACHINE ROOM DOOR TO BE A MINIMUM OF 30" WIDE AND SWING OUTWARD (BY OTHERS)
- © LIGHT SWITCH TO BE INSTALLED ADJACENT TO LOCK SIDE OF THE DOOR & LIGHT MUST BE PROVIDED INSIDE MACHINE ROOM (BY OTHERS)
- D PROVIDE A DEDICATED PHONE LINE TO THE ELEVATOR MACHINE ROOM AND INSTALL IN A 4" × 4" BOX WITH COVER, MUST HAVE A MINIMUM 8'-10' TAIL (BY OTHERS)
- © 230 VAC, 2 POLE, SINGLE PHASE, FUSED DISCONNECT WITH 30 AMP RK-5 FUSES (PER NEC 2002-BY OTHERS).
- F PROVIDE 120 V, FUSED DISCONNECT OR 15 AMP CIRCUIT BREAKER FOR ELEVATOR CAB INTERIOR LIGHTS (PER NEC 2002-BY
- G FLOOR MOUNT PUMPING UNIT DIMENSIONS:  $16\frac{3}{4}$ " D  $\times$   $28\frac{3}{4}$ " L  $\times$   $26\frac{3}{4}$ " H (ON PADS)
- (H) 5'-0" MIN. HEADROOM REQ'D FOR ELEVATED PLATFORM/ STANDS.

DRAWING/ REVISION(S)			
DRAWN:	CHECKED:	DATE:	
C.J.S.	C.J.S.	03/01/09	NEW DRAWING

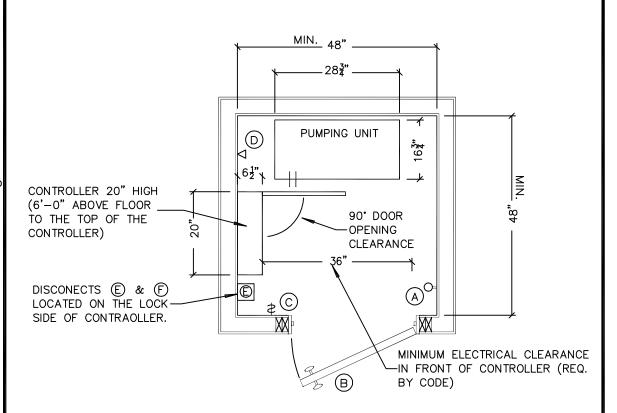

## MACHINE ROOM PLAN VIEW

SCALE - NOT TO SCALE

NOTE: ALL DIMENSIONS ARE APPROXIMATE